


GENERAL DESCRIPTION

Perforated pipe systems can be thought of as long infiltration trenches or linear soak-aways that are designed for both conveyance and infiltration of stormwater runoff. They are composed of perforated pipes installed in gently sloping granular stone beds that are lined with geotextile fabric that allow infiltration of runoff into the gravel bed and underlying native soil while it is being conveyed from source areas or other BMPs to an end-of-pipe facility or receiving waterbody. Perforated pipe systems can be used in place of conventional storm sewer pipes, where topography, water table depth, and runoff quality conditions are suitable. They are suitable for treating runoff from roofs, walkways, parking lots and low to medium traffic roads, with adequate pretreatment. Perforated pipe systems can also be referred to as pervious pipe systems, exfiltration systems, clean water collector systems and percolation drainage systems.

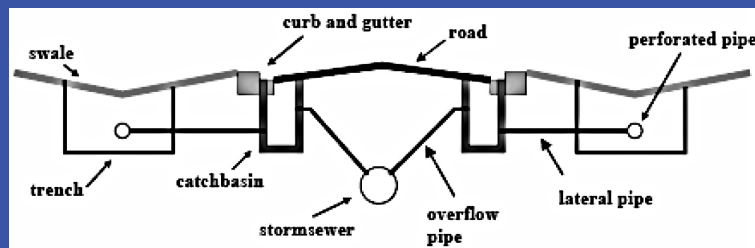

CONSTRUCTION CONSIDERATIONS

Soil Disturbance and Compaction


Before site work begins, locations of facilities should be clearly marked. Only vehicular traffic used for construction of the infiltration facility should be allowed close to the facility location.

Erosion and Sediment Control

Infiltration practices should never serve as a sediment control device during construction. Construction runoff should be directed away from the proposed facility location. After the site is vegetated, erosion and sediment control structures can be removed.



Source: STEP

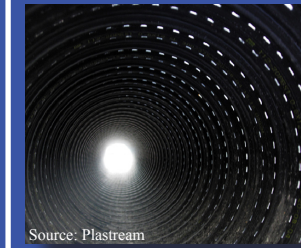

Source: Plastream

DESIGN GUIDANCE

SOIL CHARACTERISTICS

Perforated pipe systems can be constructed over any soil type, but hydrologic soil group A or B soils are best for achieving water balance objectives. If possible, facilities should be located in portions of the site with the highest native soil infiltration rates. Designers should verify the native soil infiltration rate at the proposed location and depth through measurement of hydraulic conductivity under field saturated conditions.

GEOMETRY AND SITE LAYOUT

Gravel beds in which the perforated pipes are installed are typically rectangular excavations with a bottom width between 600 and 2400 mm. The gravel beds should have gentle slopes between 0.5 to 1%.

PRE-TREATMENT

It is important to prevent sediment and debris from entering infiltration facilities because they could contribute to clogging and failure of the system. The following pre-treatment devices are options:


- *In-ground devices:* Devices placed between a conveyance pipe and the facility (e.g., oil and grit separators, sedimentation chambers, goss traps), that can be designed to remove both large and fine particulate from runoff. A number of proprietary filter designs are also available.
- *Vegetated filter strips or grass swales:* Road and parking lot runoff can be pretreated with vegetated filter strips or grass swales prior to entering the infiltration practice.

CONVEYANCE AND OVERFLOW



Collection and conveyance of runoff into the perforated pipe system can be accomplished through conventional catchbasins and non-perforated pipes leading from foundation drains and roof downspouts. Perforated pipes should be smooth walled to reduce the potential for clogging and facilitate clean out. The gravel filled trench should be 75 to 150 mm deep above the perforated pipe. On-line concrete, clay or plastic trench baffles or other barriers can be installed across the granular filled trench to reduce flow along the system, thereby increasing the potential for infiltration. Overflows from the granular filled trench should either back up into manholes that are also connected to conventional storm sewers or be conveyed to a storm sewer or receiving waterbody by overland flow.

FILTER MEDIA

- *Gravel filled trench:* Should be filled with uniformly-graded, washed, 50 mm clear stone that provides 40% void space.
- *Geotextile:* A non-woven needle punched, or woven monofilament geotextile fabric should be installed around the stone reservoir of perforated pipe systems with a minimum overlap at the top of 300 mm.

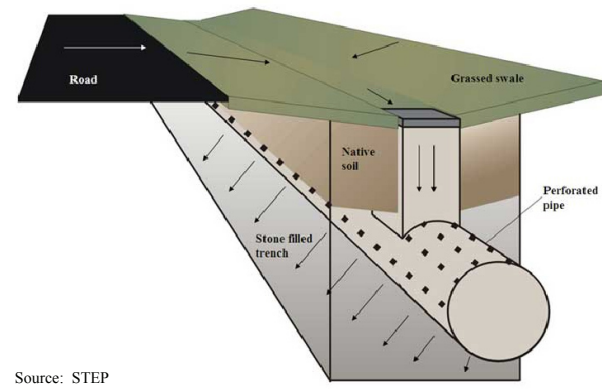

Source: STEP

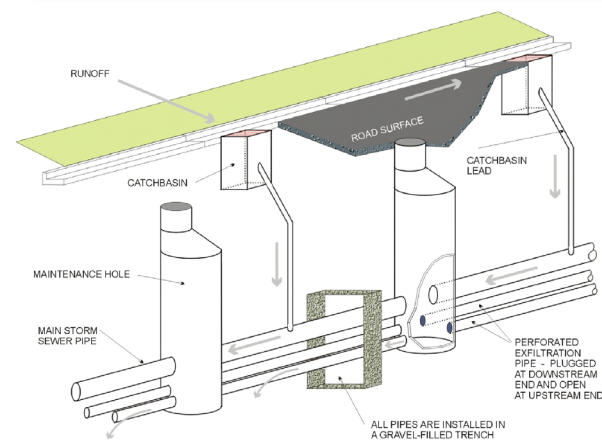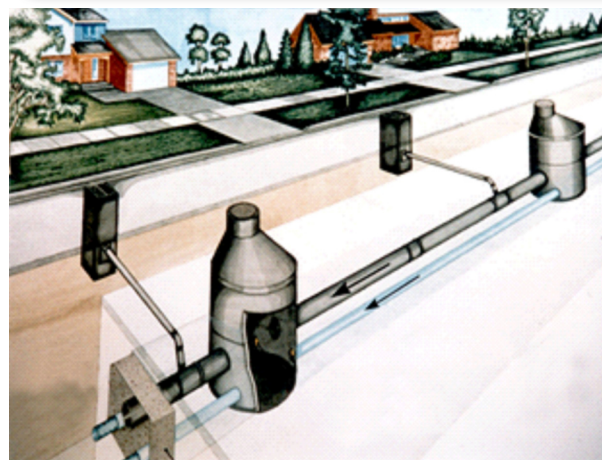

COMMON CONCERNS

Risk of Groundwater Contamination

Most pollutants in urban runoff are well retained by infiltration practices and soils and therefore, have a low to moderate potential for groundwater contamination. To minimize risk of groundwater contamination the following management approaches are recommended:

- infiltration practices should not receive runoff from high traffic areas where large amounts of de-icing salts are applied (e.g., busy highways), nor from pollution hot spots;
- prioritize infiltration of runoff from source areas that are comparatively less contaminated such as roofs, low traffic roads and parking areas; and,
- apply sedimentation pretreatment practices (e.g., oil and grit separators) before infiltration of road or parking area runoff.

Standing Water and Mosquitoes

Complete drawdown should occur within 72 hours after a storm event, before mosquitoes have an opportunity to breed.

Foundations and Seepage

Should be setback at least four (4) metres from building foundations to prevent basement flooding and damage during freeze/thaw cycles.

Winter Operation

Perforated pipe systems will continue to function during winter months if the inlet pipe and top of the gravel bed is located below the local maximum frost penetration depth.

Risk of Soil Contamination

Available evidence from monitoring studies indicates that small distributed stormwater infiltration practices do not contaminate underlying soils, even after 10 years of operation.

Maintenance

With proper location and adequate pretreatment, perforated pipe systems can continue to function effectively with very low levels of maintenance activities. Like conventional stormwater conveyance infrastructure (i.e., catchbasins and storm sewers), perforated pipe systems are typically located on public property (e.g., within road rights-of-way). An advantage to incorporating these systems in stormwater management systems is that legal agreements with property owners or managers, to ensure long term operation and maintenance, are not needed.

GENERAL SPECIFICATIONS

Material	Specification	Quantity
Perforated pipe	Pipe should be continuously perforated, smooth interior, with a minimum inside diameter of 200 millimetres.	Perforated pipe should run lengthwise through the facility at least 100 mm above the bottom of the gravel filled trench. Non-perforated pipe should be used for conveyance to the facility.
Stone	The trench in which perforated pipes are installed should be filled with washed 50 mm clear stone with a 40% void ratio.	Volume is based on trench dimensions and a void ratio of 40%.
Geotextile	Material specifications should conform to Ontario Provincial Standard Specification (OPSS) 1860 for Class II geotextile fabrics. Should be woven monofilament or non-woven needle punched fabrics. Woven slit film and non-woven heat bonded fabrics should not be used as they are prone to clogging. Primary considerations are: <ul style="list-style-type: none"> • Suitable apparent opening size (AOS) for non-woven fabrics, or percent open area (POA) for woven fabrics, to maintain water flow even with sediment and microbial film build-up; • Maximum forces that will be exerted on the fabric (i.e., what tensile, tear and puncture strength ratings are required?); • Load bearing ratio of the underlying native soil (i.e., is geotextile needed to prevent downward migration of aggregate into the native soil?); • Texture (i.e., grain size distribution) of the overlying native soil, filter media soil or aggregate material; and • Permeability of the native soil. 	Around the gravel filled trench (stone reservoir).
For further guidance see CVC/TRCA LID SWM Planning and Design Guide, Table 4.10.4		

ABILITY TO MEET SWM OBJECTIVES

BMP	Water Balance Benefit	Water Quality Improvement	Stream Channel Erosion Control Benefit
Perforated Pipe Systems	Yes	Yes	Partial, depends on soil infiltration rate

OPERATION AND MAINTENANCE

Maintenance typically consists of cleaning out leaves, debris and accumulated sediment caught in pretreatment devices annually or as needed. Inspection via manholes should be performed to ensure the facility drains within the maximum acceptable length of time (typically 72 hours) at least annually and following every major storm event (>25 mm). If the time required to fully drain exceeds 72 hours, drain via pumping and clean out the perforated pipe by flushing. If slow drainage persists, the system may need removal and replacement of granular material and/or geotextile liner. Perforated pipe systems should be located below shoulders of roadways, pervious boulevards or grass swales where they can be readily excavated for servicing.

SITE CONSIDERATIONS



Site Topography
Systems cannot be located on natural slopes greater than 15%. The gravel bed should be designed with gentle slopes between 0.5 to 1%.



Drainage Area
Typically designed with an impervious drainage area to treatment facility area ratio of between 5:1 to 10:1.



Soil
Perforated pipe systems can be located over any soil type, but hydrologic soil group A and B soils are best for achieving water balance benefits. Facilities should be located in portions of the site with the highest native soil infiltration rates. Native soil infiltration rate at the proposed facility location and depth should be confirmed through measurement of hydraulic conductivity under field saturated conditions.



Wellhead Protection
Facilities receiving road or parking lot runoff should not be located within two (2) year time-of-travel wellhead protection areas.



Water Table
The bottom of the gravel bed should be separated from the seasonally high water table or top of bedrock elevation by at least one (1) metre to prevent groundwater contamination.



Pollution Hot Spot Runoff
To protect groundwater from possible contamination, source areas where land uses or human activities have the potential to generate highly contaminated runoff (e.g., vehicle fueling, servicing and demolition areas, outdoor storage and handling areas for hazardous materials and some heavy industry sites) should not be treated by perforated pipe systems.



Setback from Buildings
Facilities should be setback a minimum of four (4) metres from building foundations.



Proximity to Underground Utilities
Local utility design guidance should be consulted to define the horizontal and vertical offsets. Generally, requirements for underground utilities passing near the practice will be no different than for utilities in other pervious areas.

CVC/TRCA LOW IMPACT DEVELOPMENT PLANNING AND DESIGN GUIDE - FACT SHEET

PERFORATED PIPE SYSTEMS